

5. Contact factory for lead times on warm white.

10. If ordered with DIM, APD, MRI, MR50, APD-MRI,

APD-MRO, dimming will not be connected to NEMA

6. Not configurable with Type 5 (5) Optics.

8. Not configurable with 480V (480) Voltage.

dimming device.

receptacle.

2. MR50 and APD-MRO luminaires require one motion 7. Not configurable with 120-277V (UNV) Voltage.

3. ECF-MRI requires outboarded sensor when used with 9. Works with 3-pin or 5-pin NEMA photocell/

sensor per pole, ordered separately. See page 2 for Voltage must be specified.

for 3"-3.9" O.D.

Bird Deterrent

11. Works with 3-pin or 5-pin NEMA photocell/dimming

12. Not configurable with 3@120 (3@120) Mounting.

13. No adaptor required for 4" round poles.

RPAs provided with Black Paint standard.

(for future use only).

(field installed only)

mounting heights

LLC4^{1,4} #4 lens for

1. Available in 120V–277V Voltages only

(UNV, 120, 208, 240 & 277).

Terminal Block (TB) Option.

See page 6-7 for more info.


EcoForm_ECF_LED 03/16 page 1 of 8

21-40' mounting heights

Accessories. Available in 120V or 277V only.

configurable with PC/PCB/PCR5/PCR7 Options.

4. LLC2/LLC3/LLC4 Wireless Controls are not

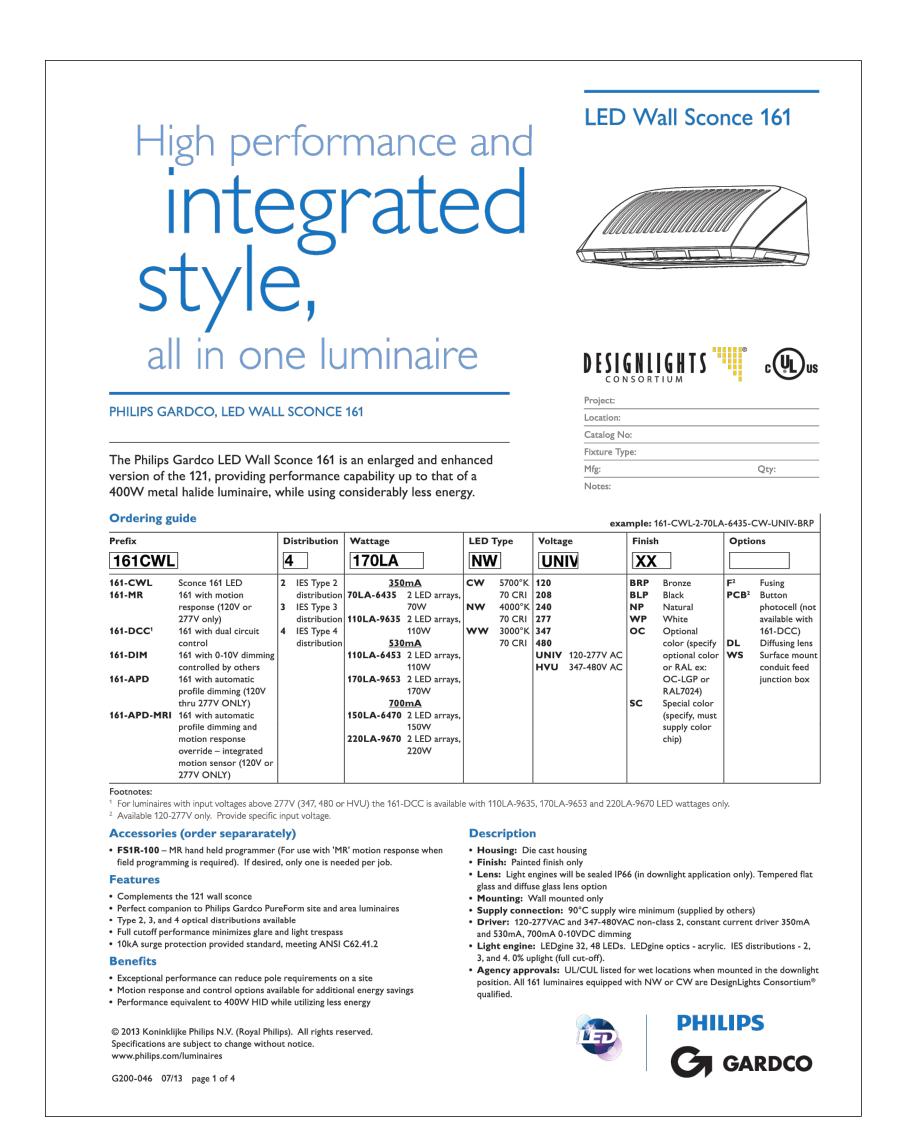

ATIONS

SPECIFIC/ HING

ALL DOCUMENTS PREPARED BY PENNONI ASSOCIATES ARE INSTRUMENTS OF SERVICE IN RESPECT OF THE PROJECT. THEY ARE NOT INTENDED OR REPRESENTE TO BE SUITABLE FOR REUSE BY OWNER OR OTHERS O THE EXTENSIONS OF THE PROJECT OR ON ANY OTHER PROJECT. ANY REUSE WITHOUT WRITTEN VERIFICATION OR ADAPTATION BY PENNONI ASSOCIATES FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT OWNERS SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO PENNONI ASSOCIATES; AND OWNER SHALL INDEMNIFY AND HOLD HARMLESS PENNONI

ASSOCIATES FROM ALL CLAIMS, DAMAGES, LOSSES ANI EXPENSES ARISING OUT OF OR RESULTING THEREFROM LCGR1601 PROJECT 2017-12-01 DRAWING SCALE 1"= 60' DRAWN BY APPROVED BY